

Project of common interest:

2.24

COUNTRIES INVOLVED

Belgium (BE)

PROJECT PROMOTERS

Elia System Operator SA (BE)

BASIC TECHNICAL DATA

Voltage: 380 kV

LOCATION


Belgian North Border to the Netherlands

COMMISSIONING DATE

2019

Electricity interconnection

North-South electricity interconnections in Western Europe

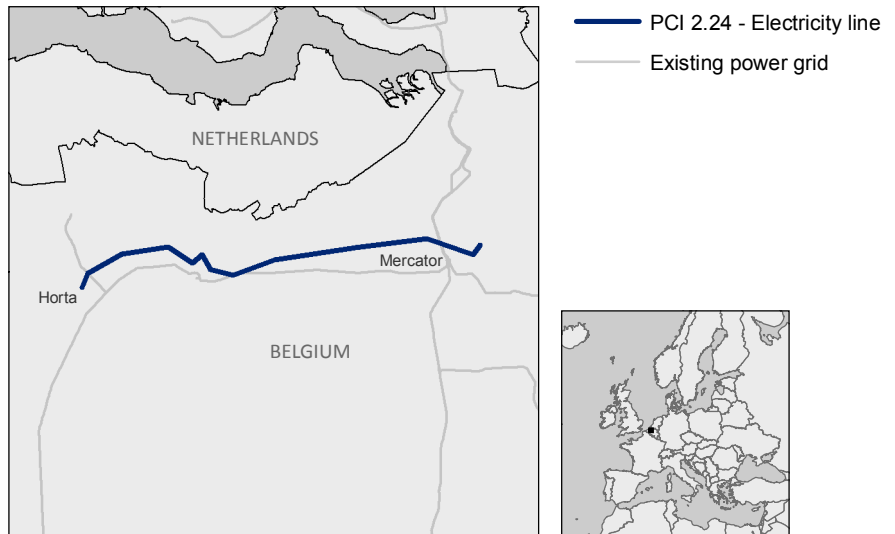

Source: PLATTS, GISCO, European Commission

Definition

2.24 - Internal line between Horta-Mercator (BE)

Type of technology employed

The project consists of replacing the conductors of the double circuit 380 kV overhead line between the substations of Horta and Mercator with high performance conductors, hereby doubling its transport capacity.

The circuit currently passing Mercator going to Doel will be integrated into the Mercator substation to obtain a better flux balance and avoid an upgrade between Mercator and Doel at this stage.

Implementation status

Under construction