

Project of common interest:

3.22.2

#### COUNTRIES INVOLVED

Romania (RO)

#### PROJECT PROMOTERS

C.N.T.E.E. TRANSELECTRICA S.A.(RO)  
www.transelectrica.ro

#### LOCATION


Portile de Fier to Resita (RO)

#### COMMISSIONING DATE

2021

## Electricity interconnection

### North-South electricity interconnections in Central Eastern and South Eastern Europe

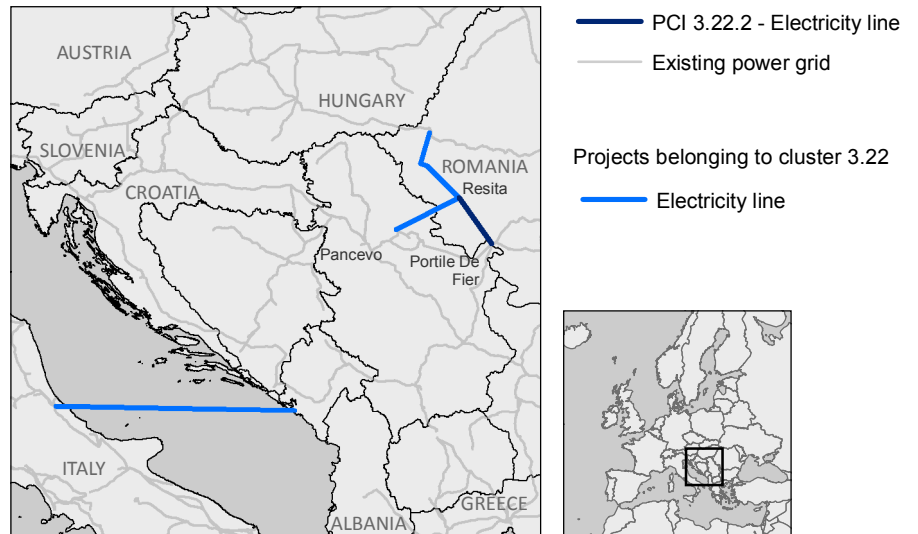

Source: PLATTS, GISCO, European Commission

#### Definition

3.22.2 - Internal line between Portile de Fier and Resita (RO)

#### Cluster

PCI 3.22.2 - belonging to cluster 3.22: Cluster Romania – Serbia between Resita and Pancevo

#### Type of technology employed

New 400 kV AC OHL of 116 km and with a capacity of 1380 MVA between existing substation 400 kV Portile de Fier and new 400 kV substation Resita, extension with one bay of 400 kV substation Portile de Fier, new 400 kV substation Resita, with 400/220 kV and 400/110 kV transformers, as development of the existing 220/110 kV substation.

#### Implementation status

Permitting

#### LAST UPDATE

March 2018

Energy

Note: The project location as depicted on the map is indicative only. The final location will be determined once the permit granting procedure has been completed.